BIOGENESIS

Biogenesis S.r.l. www.bio-genesis.it

AUTOMATIC DEVICE "MARE SERIES" 3-6-12 Kg Gas HFC

In new installations, the devices for



CYLINDER

- Gas HFC 227 ea.
- PROPELLANT

Automatic M. 30x1.5, set 93 °C. (with bulb in standard equipment) Supplied with pressure switch set at 11 bar.

A B fire rating

ACTIVATION

- Automatic when bulb temperature

- is reached. On request (see optional):
- with manual actuator with handle; - with pyrotechnic cartridge for electric activation.

BRACKET

Wall-mounted in standard equipment.

Gas HFC Automatic Device, Mare Series, available charge 3, 6, 12 Kg, temperature range from -30°C to +60°C, certified according to the directive for pressure equipment PED 2014/68/EU. RINA certified, ISO 9094:2015. Quality Product certification guaranteed by Bureau Veritas Italia.

Suitable for use on fire involving electrical voltages up to 1 000 V, at a distance of 1 mt.


Note: image is for illustrative purpose only, the product purchased can has some differences

AV	AILABLI	E VERSIONS						
	GAS HFC QUANTITY	DIMENSIONS (without bracket) H x L max x Ø cylinder (mm)	M3/Kg	C % (concentration gas in volume)	DISTRIBUTION TUBE LENGTH	NUMBER OF NOZZLE	DISCHARGE TIME	COVERAGE AREA
	Kg 3	440 +/-5 x 140 +/-3 x 130 +/-1	0,1373	7,611	recommended 5 m	Based on choice of dispensing points of installation	20 sec.	5 c.m.
	Kg 6	490 +/-5 x 160 +/-3 x 160 +/-3	0,1373	7,611	recommended 5 m		35 sec.	10 c.m.
	Kg 12	590 +/-5 x 190 +/-3 x 190 +/-3	0,1373	7,611	recommended 8 m		60 sec.	20 c.m.
APPROVE	D/CERTIFIED D	EVICE:	·	• •				

switch








AUTOMATIC DEVICE "MARE SERIES" 3-6-12 Kg Gas HFC

TECHNICAL SPECIFICATIONS

FIRE RATING	A B
EXTINGUISHING AGENT	Gas HFC 227 ea
PROPELLANT	Nitrogen (N ₂), 15 Bar at 20 °C
TEMPERATURE RANGE	-30°C / +60°C
CYLINDER PRESSURE TEST	PT 27 bar
VALVE TIGHTENING TORQUE	Between 40 and 50 Nm
CYLINDER MATERIAL	Alloy steel
EXTERNAL/INTERNAL TREATMENT	Sandblast and epoxypolyestere powder painting, Red Ral 3000 colour


PACKAGING STANDARD : single packaging



MAINTENANCE AND INSTALLATION

Install the system in vertical position using the supplied bracket. Place the gas distribution pipe and fix the nozzles. Remove the safety pin to make operating system.

Recommended maintenance : every 6 months check pressure; every 72 months replace extinguishing agent; test after 144 months of production date.

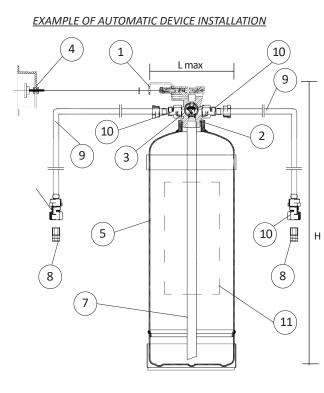

SPARE PARTS

SPARE PARTS							
Ν.	N. DESCRIPTION						
1	Valve M. 30x1.5 with thermosensible bulb for activation at 93°C						
2	Valve o-ring						
3	Pressure gauge						
4 - OPTIONAL	Manual actuator in control box(cable 5 m)						
5	Cylinder 3 Kg Cylinder 6 Kg Cylinder 12 Kg						
6	Iron bracket 3 Kg Iron bracket 6 Kg Iron bracket 12 Kg						
PVC dip tube 3 Kg 7 PVC dip tube 6 Kg PVC dip tube 12 Kg							
8 - OPTIONAL	Brass dispensing nozzle M 3/8"						
9 - OPTIONAL	Aluminum distribution tube Ø 10, PVC coated						
10 - OPTIONAL	Fitting F 3/8" for distribution tube						
OPTIONAL	Pyrotechnic cartridge						
11	Label						
	Pressure switch 1/8" for valve, set at 11 bar						

© REPRODUCTION IS PROHIBITED